

# 3-WAY BOTTOM ENTRY™

## JUNCTION BOX - Ex eb I, Ex eb IIC, Ex ec IIC, Ex tc IIIC

## for Hazardous Area Installations

## **Features and Benefits**

- 3-Way Bottom Entry<sup>™</sup> Box for hazardous area lighting installations.
- For use in Group I mining (low impact areas), Group II and Group III applications.
- Screw-on lid provides ease of installation. Lid locking with a special key prevents unauthorized tampering.
- Supplied complete with safety securing lid lanyard.
- Only approved CCG cable glands and terminals must be used. No exposed metal parts.
- Dust and waterproof to IP66/68, when used with CCG sealed cable glands.
- No drilling or tapping of cable entries required.
- Mounting studs provided for DIN rail if using terminal blocks.
- Internal earthing to all entries and rail provided.











## **Technical Data**

Inserts

3-Way Bottom Entry<sup>™</sup> Box Impact corrosion and UV resistant glass reinforced polyester compound Box Material:

Polycarbonate (see-through adapt-a-lids)

O ring seals: Silicone or Sarlink seals. Terminals: Wellamid or Wemidd

Brass internal earthing and rail mountings
Certified Terminals, 3-Blanking Plugs and Box Spanner (Lid Locking Key) Optional Accessories: Note:

The installer should check that the materials are suitable for the

installation environment.

## **Standards and Certifications**

Equipment Protection Levels: SANS: (Finished)Ex e IIC T6 Gb / Ex nA IIC T6 Gc / Ex tb IIIC T70°C Db

SANS: (Unfinished) Ex e IIC Gb / Ex nA IIC Gc / Ex tb IIIC Db

IECEX/INMETRO: (Finished) Ex eb I Mb / Ex eb IIC T6 Gb / Ex ec T6 Gc / Ex tb IIIC T70°C Db / Ex tc IIIC T70°C Dc

IECEx/INMETRO: (Unfinished) Ex eb I Mb / Ex eb IIC Gb / Ex ec Gc / Ex tb IIIC Db / Ex tc IIIC Dc

Cartificato

**Ambient Temperature:** -60°C to +110°C (Unfinished) Service Temperature:

Officialice.	Stariuaru.	Certificate.	
IECEx	IEC 60079 Part 0, 7, 31, IEC 60529	IECEx MSC 20.0003X	(Finished)
	IEC 60079 Part 0, 7, 31, IEC 60529	IECEx MSC 20.0004U	(Unfinished)
ATEX	EN 60079 Part 0, 7, 31	CML 14ATEX3036X	(Finished)
	EN 60079 Part 0, 7, 31	CML 14ATEX4038X	(Finished)
	EN 60079 Part 0, 7, 31	CML 14ATEX3037U	(Unfinished)
	EN 60079 Part 0, 7, 31	CML 14ATEX4039U	(Unfinished)
UKEX	EN/BS 60079 Part 0, 7, 31	CML 21UKEX3008X	(Finished)
	EN/BS 60079 Part 0, 7, 31	CML 21UKEX4010X	(Finished)
	EN/BS 60079 Part 0, 7, 31	CML 21UKEX3007U	(Unfinished)
	EN/BS 60079 Part 0, 7, 31	CML 21UKEX4009U	(Unfinished)

INMETRO (Brazil) ABNT NBR IEC 60079 Part 0, 7, 31,

IEC 60529

ABNT NBR IEC 60079 Part 0, 7, 31,

IEC 60529

TR CU (Russia) ГОСТ 31610-0, 15, ГОСТ Р МЭК 60079-7, 31 GB 3836.0, 3, GB 12476.1, 5 CNEx (Chinese)

GB 3836.0, 3, GB 12476.1, 5 GB 3836.0, 3, GB 12476.1, 5 GB 3836.0, 3, GB 12476.1, 5

SANS/IEC 60079 Part 0, 7, 31 SANS SANS/IEC 60529 IP66/68 2m Protection IEC 60529

Marine ABS IEC 60529 DNV-GI IFC 60529 ClassNK IEC 60079 Part 0, 7, 31 **Deluge Protection** DTS-01

Short Circuit/ Cont. Current IEC 60947-7-2, IEC 62444

TÜV 15.0481X

TÜV 15.0482U (Unfinished) EA9C RU C-ZA.HA91.B.00243/21

CNEx 21.3507X CNEx CCC 2021312303000506 (Finished) CNEx 21.3390X (Unfinished) CNEx CCC 2021312313000393 (Unfinished) MASC S/21-9001X (Finished) (Unfinished)

MASC S/21-9002X IECEx CML 15.0071U ABS 20-SG1952738-1-PDA DNV-GL TAE0000011

TA20268M CML 14CA370-1


CATAPULT OR/15/11677\_2




#### Conditions for Safe Use - X

- In Group I applications, the junction box must only be used in low impact areas and where it is not exposed to oils or greases.
- Only the CCG tool supplied shall be used for opening / closing the enclosure.
- Suitably certified cable glands and/or plugs shall be used in the enclosure threaded entries
- Terminal blocks shall only be used on the applicable rail and shall allow sufficient space to make connections and to close the cover / lid.
- Only the Weidmuller terminals shown in Table 2 may be used.
- The creepage and clearance between terminal blocks and from the terminal block to any earthed / bonded metallic part shall comply with the EN60079-7 requirements for the acceptable voltage of the terminal blocks.

•	The current in the junction box is limited by the size of the conductor and shall not exceed the following:								
	Product Code	Box Size Reference	Entry Thread 'A'	Inside Dimension 'B'	Internal Diameter 'C'	Mounting Centres 'D'	Rail Mounting Centres 'E'	Outer Height 'F'	Dim. 'I'
1	00201-B	1	M20 x 1.5	68.0	101.0	132.0	80.0	124.0	-
1	00202-B	2	M25 x 1.5	100.0	123.0	162.0	92.0	160.0	81.0



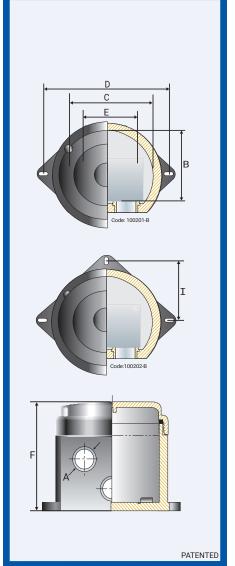

Current

≤ 40°C Ambient

11.90 A

15.86 A

20,33 A

28,26 A

37,68 A

61,98 A

74,88 A

≤ 55°C Ambient

8.34 A

11.12 A

14,25 A

19,81 A

26,42 A

43,46 A

52.50 A

Conductor /

2.5 mm<sup>2</sup>

4 mm<sup>2</sup>

6 mm<sup>2</sup>

10 mm<sup>2</sup>

16 mm<sup>2</sup>

35 mm<sup>2</sup>

 $50 \text{ mm}^2$ 

Terminal Block

2022 @ CCG CABLE TERMINATIONS (PTY) LTD

# 3-WAY BOTTOM ENTRY™ JUNCTION BOX



## Wiring and Installation instructions for 3-Way Bottom Entry™ Box without components

- · Installation must be carried out by a competent person.
- The box must not be modified in any way, as this will invalidate the certification.
- Where cables enter the box they must be secured by CCG Cable Glands appropriate to the make up of the cable.
- · Unused entry apertures must be blanked with certified CCG Blanking Plugs.
- To maintain IP 66/68 a thread seal gasket between the box and cable gland must be installed.
- · Before replacing the lid, ensure the lid gasket is in place.
- The use of a CCG Box Spanner (Lid Locking Key) is required to maintain the tamper proof integrity of the box, refer Figure 1.

## Wiring and Installation instructions for 3-Way Bottom Entry™ Box with components


- Installation must be carried out by a competent person.
- · Do not install under live current conditions.
- The box must not be modified in any way, as this will invalidate the certification.
- · All wiring must be carried out in accordance with the relevant Codes of Practice.
- The wiring insulation must not extend by more than 1.0mm from the metal face of the terminal as shown in Figure 2.
- The voltage and current value of the box must not be exceeded.
   See relevant certificate for current limitations for conditions of use / schedule of limitations.
- Only those terminals shown in the terminal schedule may be incorporated in the box, refer Table 1.
- Inner cable bedding must protrude into the box by a minimum of 20mm past the cable entry point.
- Not more than one single or multiple strand lead shall be connected into either side
  of the terminals.
- Only earth conductors of equal size shall be connected with rail mounted terminals.
- · All terminal screws used and unused shall be tightened.
- A parallel shaft screw driver of the correct size should be used for rail mounted terminals screws.
- Where cables enter the box they must be secured by CCG Cable Glands appropriate
  to the make up of the cable.
- Unused entry apertures must be blanked with certified CCG Blanking Plugs.
- To maintain IP66/68 a thread seal gasket between the box and cable gland must be installed.
- Before replacing the lid, ensure the lid gasket is in place.
- The use of a CCG Box Spanner (Lid Locking Key) is required to maintain the tamper proof integrity of the box, refer Figure 1.

## TABLE 1

Box Type	Box Size	Terminal Type and Size	Max Quantity	Rail Size
3-Way BE Box	1	4mm² mini terminal	8	15
3-Way BE Box	2	2.5mm <sup>2</sup>	12	35
3-Way BE Box	2	4mm²	10	35
3-Way BE Box	2	4mm² mini terminal	12	15
3-Way BE Box	2	6mm²	8	35
3-Way BE Box	2	10mm <sup>2</sup>	7	35
3-Way BE Box	2	16 mm²	6	35
3-Way BE Box	2	35mm²	3	35

#### **FIGURE 1**

To ensure the box apparatus is tamper proof: Screw on, tighten and lock lid in place by means of a CCG Box Spanner (Lid Locking Key).

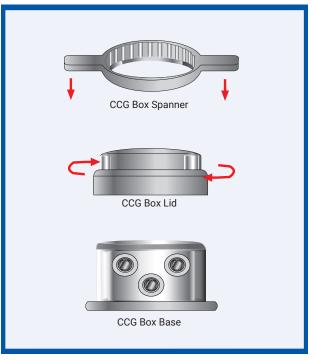

#### **CCG Box Spanner**

Product Code	Box Size
401501	20mm
401502	25mm

## TABLE 2

## **VOLTAGE PER TERMINAL CONFIGURATION**

Terminals	Volt	Earth Terminals
AKZ 4	275V	AKE 4
WDU 2.5	550V	WPE 2.5
WDU 4	550V	WPE 4
WDU 6	550V	WPE 6
WDU 10	550V	WPE 10
WDU 16	550V	WPE 16
WDU 35	550V	WPE 35









