

THERMAL INSTRUMENT Co.

217 Sterner Mill Road, Treviso, PA 19053

Telephone No. (215) 355-8400

FAX No. (215) 355-1789

Email: office@thermalinstrument.com

Hot Tapping Options

For

Flow Meter 62-9

MODEL:

62-9

220VAC

110VAC

24 VDC

Factory Set

THERMAL INSTRUMENT Co.

217 Sterner Mill Road, Trevoze, PA 19053

Telephone No. (215) 355-8400

FAX No. (215) 355-1789

Email: office@thermalinstrument.com

PACKING GLAND

SIZE: 3/4" MNPT

BODY MATERIAL : STAINLESS STEEL

INSERT : TEFLON

REDUCING COUPLING

SIZE: 1" TO 3/4"

MATERIAL: STAINLESS STEEL

SLEEVE


SIZE: 1" PIPE SCH 40 X 4" LENGTH

MATERIAL : STAINLESS STEEL

VALVE

SIZE: 1" FULL PORT

MATERIAL : STAINLESS STEEL

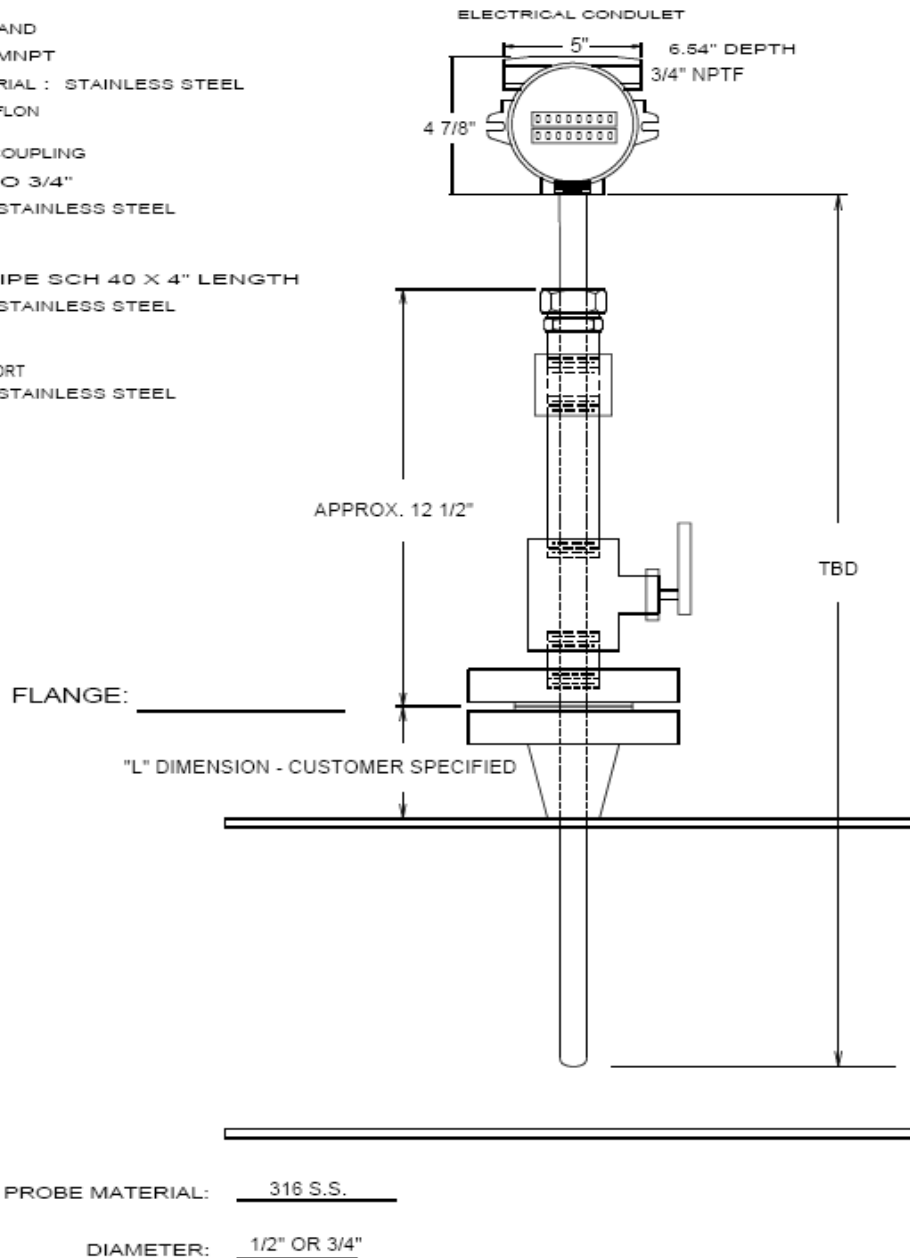

MODEL: 62-9	SERIES 62-9 INSERTION PROBE FLOW METER HOT TAP ASSEMBLY	THERMAL INSTRUMENT CO.
S/N		TREVOZE, PA
		DATE: 5/20/08

THERMAL INSTRUMENT Co.

217 Sterner Mill Road, Trevoze, PA 19053

Telephone No. (215) 355-8400

FAX No. (215) 355-1789

Email: office@thermalinstrument.com

PACKING GLAND

SIZE: 3/4" MNPT

BODY MATERIAL : STAINLESS STEEL

INSERT : TEFLON

REDUCING COUPLING

SIZE: 1" TO 3/4"

MATERIAL: STAINLESS STEEL

SLEEVE

SIZE: 1" PIPE SCH 40 X 4" LENGTH

MATERIAL : STAINLESS STEEL


VALVE

SIZE: 1" FULL PORT

MATERIAL : STAINLESS STEEL

THREAD-O-LET
(ALSO KNOWN AS PIPE SADDLE)

PLEASE CONTACT THERMAL INSTRUMENT CO.
IF ANY OTHER CONNECTION CONFIGURATION
IS USED, AS THIS MAY BE CRITICAL IN DETERMINING
PROBE LENGTH.

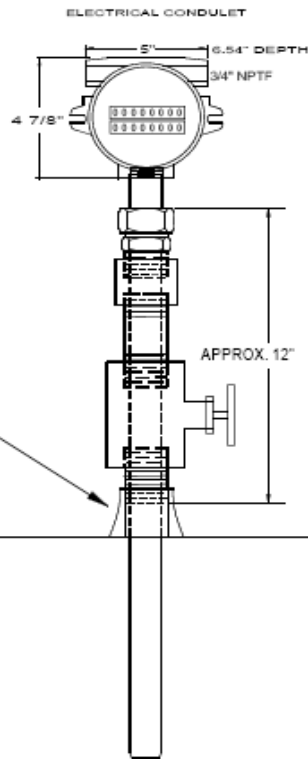

PROBE:

TOTAL LENGTH: TBD

DIAMETER: 1/2" or 3/4"

MATERIAL: 316 S.S.

MODEL: 62-9

S/N

INSTALLATION OF MODEL 62 PROBE
WITH HOT TAPPING ASSEMBLY WITH THREADED CONNECTIONS

THERMAL INSTRUMENT COMPANY
TREVOS, PA

DATE: 5/20/08

THERMAL INSTRUMENT Co.

217 Sterner Mill Road, Trevoze, PA 19053

Telephone No. (215) 355-8400

FAX No. (215) 355-1789


Email: office@thermalinstrument.com

Material:


HALF COUPLING	CARBON STEEL
PLATE	CARBON STEEL
PIPE NIPPLES	304 SS
BALL VALVE	STAINLESS STEEL
PACKING GLAND	STAINLESS STEEL
PROBE	STAINLESS STEEL

PROBE DIAMETER: 3/4" O.D.



PROBE LENGTH: TBD



USE 3/4" SOCKET

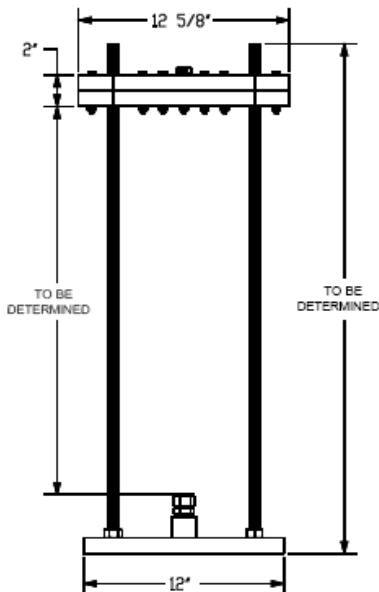

RETRACTOR ASSEMBLY

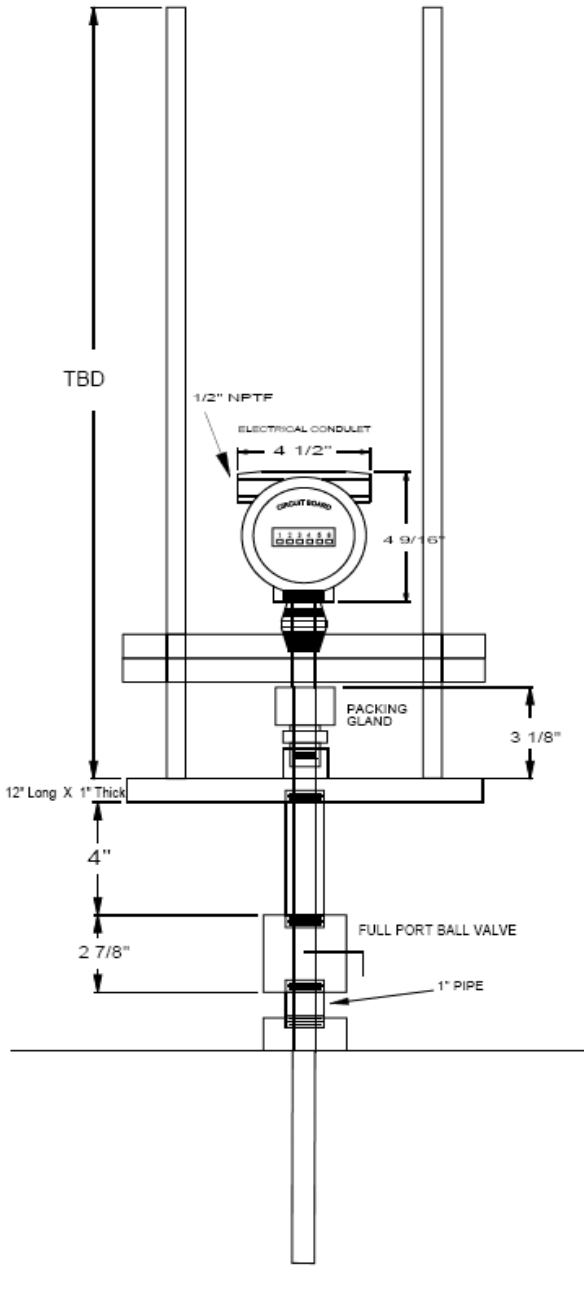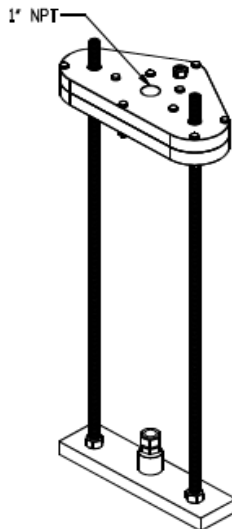

SERIAL NO.		 Thermal Instrument Company 217 Sterner Mill Road, Trevoze, PA 19053, USA	
DWO NO.: RETRACT5.DC2		DESCRIPTION: PROBE TYPE FLOW METER WITH RETRACTOR	
ORIGINATION DATE: 12/22/06		DRAWN BY: MJH	APPROVED BY: MJH
SCALE: NONE		MATERIAL: AS NOTED	PAGE: 1 of 1

THERMAL INSTRUMENT Co.

217 Sterner Mill Road, Trevoze, PA 19053

Telephone No. (215) 355-8400

FAX No. (215) 355-1789

Email: office@thermalinstrument.com

